

CUSTOMER ACCEPTANCE

NAME: _____



TITLE: _____

DATE: _____

THIS DRAWING IS FOR VISUAL REFERENCE ONLY. THE SPECIFICATIONS SHALL PREVAIL OVER THE DRAWING FOR ANY DISCREPANCIES BETWEEN THE DRAWING AND SPECIFICATIONS. NOT ALL DETAILS ARE NOTED OR SHOWN.

INTERIOR	OPENING
L1 46W X 70.25H X 15/28D	44.00W X 60.875H
L2 58W X 38H X 15D	56.00W X 28.625H
L3 44W X 70.25H X 15/28D	42.00W X 60.875H
R1 46W X 70.25H X 15/28D	44.00W X 60.875H
R2 58W X 38H X 15D	56.00W X 28.625H
R3 44W X 70.25H X 15/28D	42.00W X 60.875H
B1 39W X 28H X 36D	37.00W X 19.875H

JOB NO. FT1037
PLAQUEMINES PARISH FIRE DEPT.
1,500 GPM WATEROUS CSU PUMP
1,000 GALLON WATER TANK
30 GALLON FOAM CELL

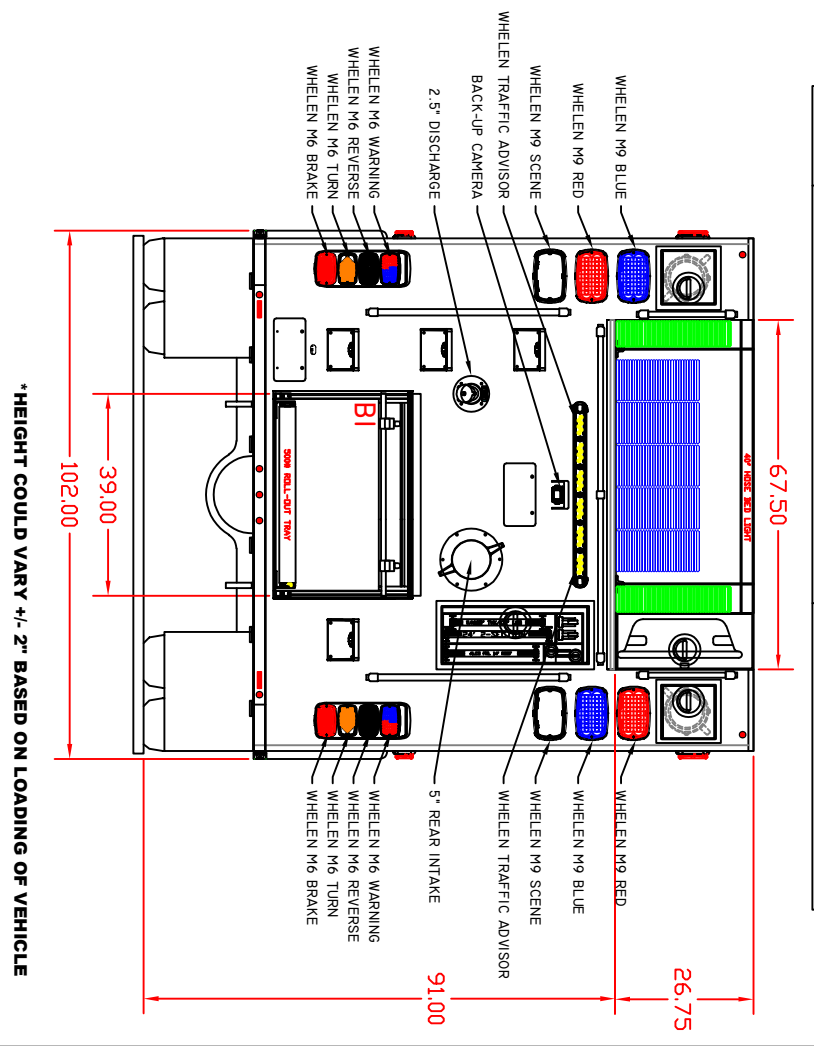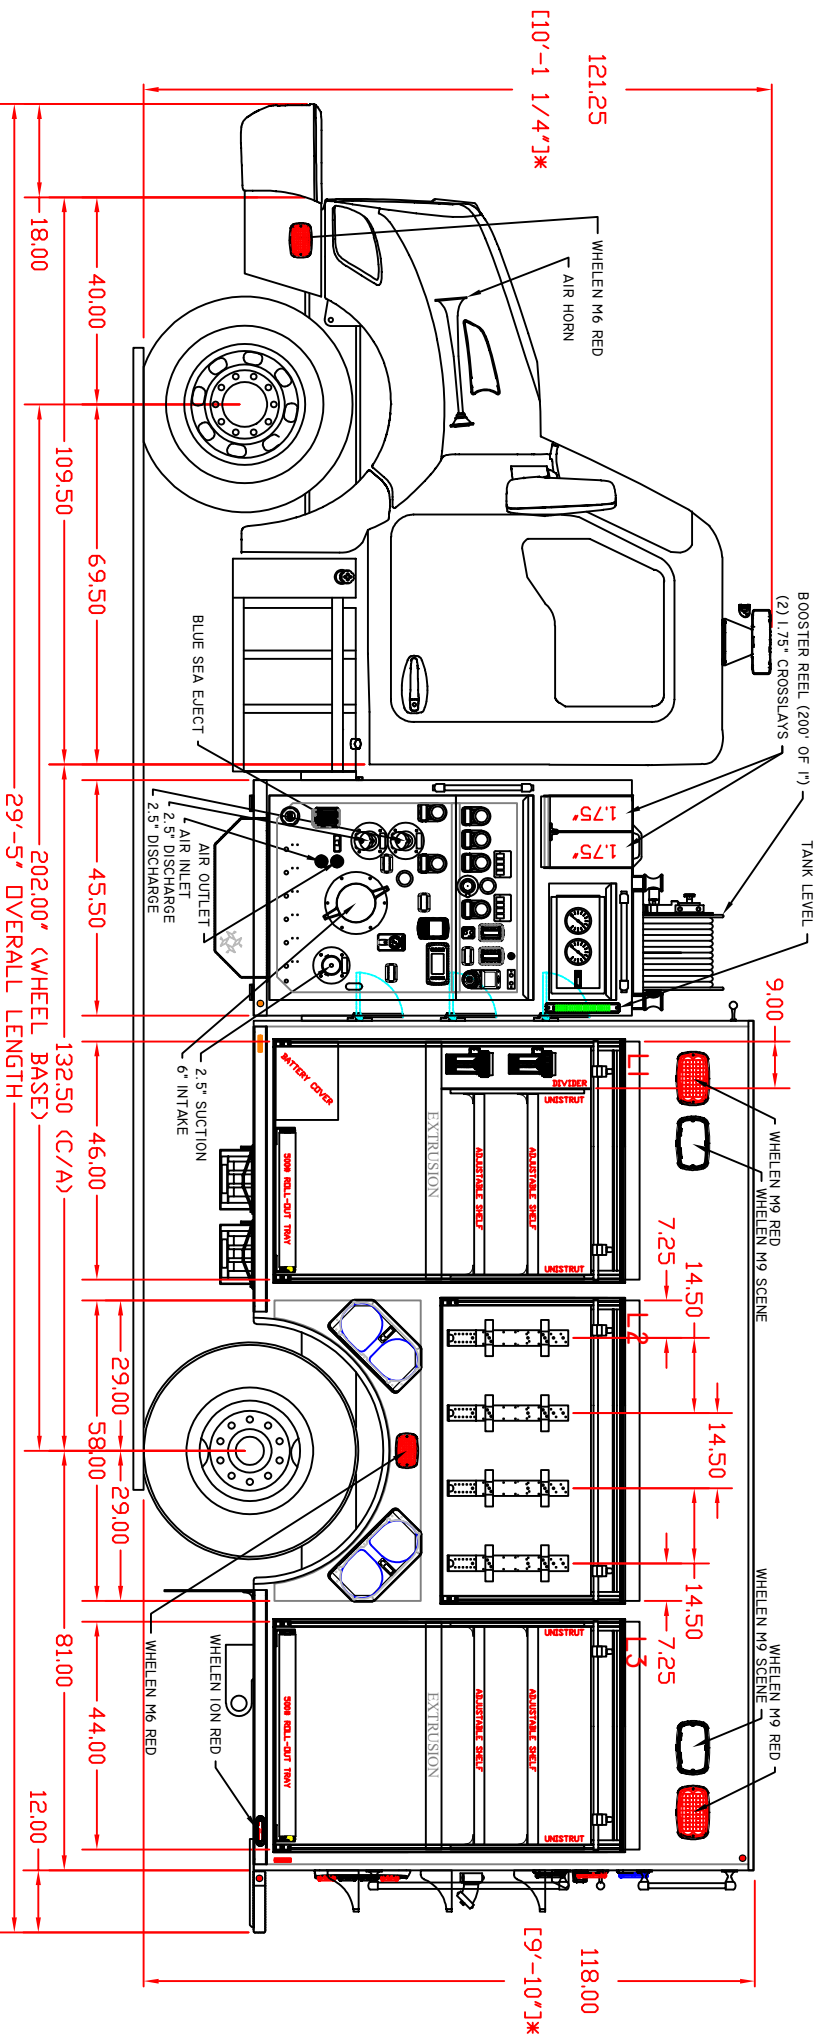

*HEIGHT COULD VARY +/- 2" BASED ON LOADING OF VEHICLE