


CUSTOMER ACCEPTANCE

NAME: _____

TITLE: _____



DATE: _____

THIS DRAWING IS FOR VISUAL REFERENCE ONLY. THE SPECIFICATIONS SHALL PREVAIL OVER THE DRAWING FOR ANY DISCREPANCIES BETWEEN THE DRAWING AND SPECIFICATIONS. NOT ALL DETAILS ARE NOTED OR SHOWN.

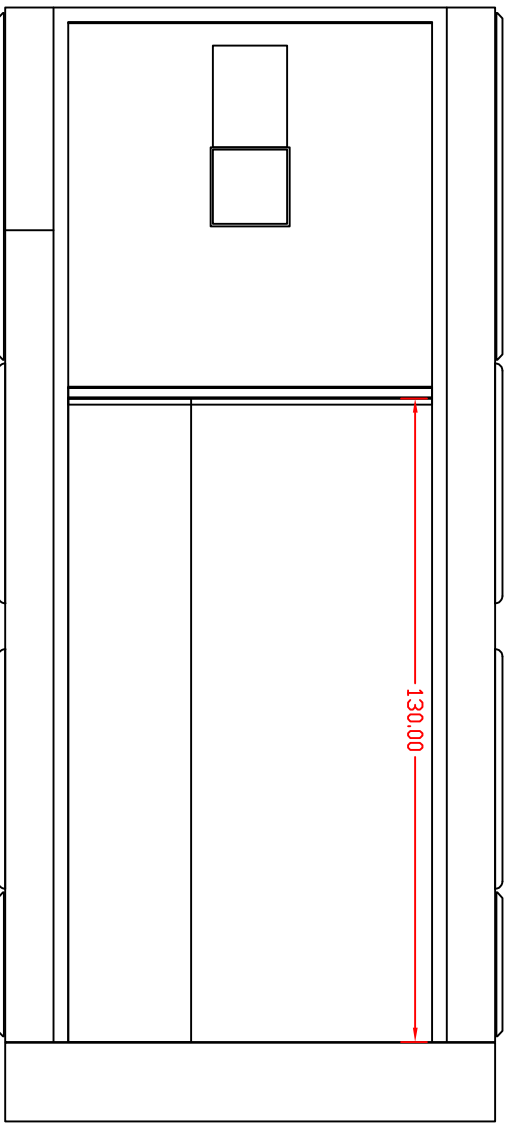

JOB NO.: FT1096
ST. JOHN VOLUNTEER FIRE DEPT.
1,500 GPM HALE GMAX-XS PUMP
3,000 GALLON WATER TANK

	INTERIOR	OPENING
L1	37W X 74.25H X 12/28D	35.00W X 64.875H
L2	23W X 29H X 28D	21.00W X 20.875H
L3	23W X 29H X 28D	21.00W X 20.875H
R1	37W X 74.25H X 12/28D	35.00W X 64.875H
R2	23W X 29H X 28D	21.00W X 20.875H
R3	23W X 29H X 28D	21.00W X 20.875H

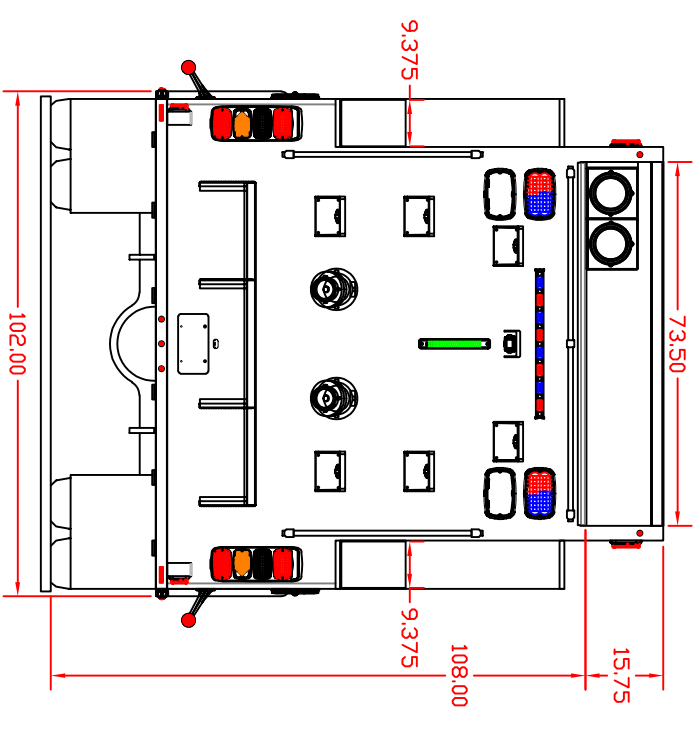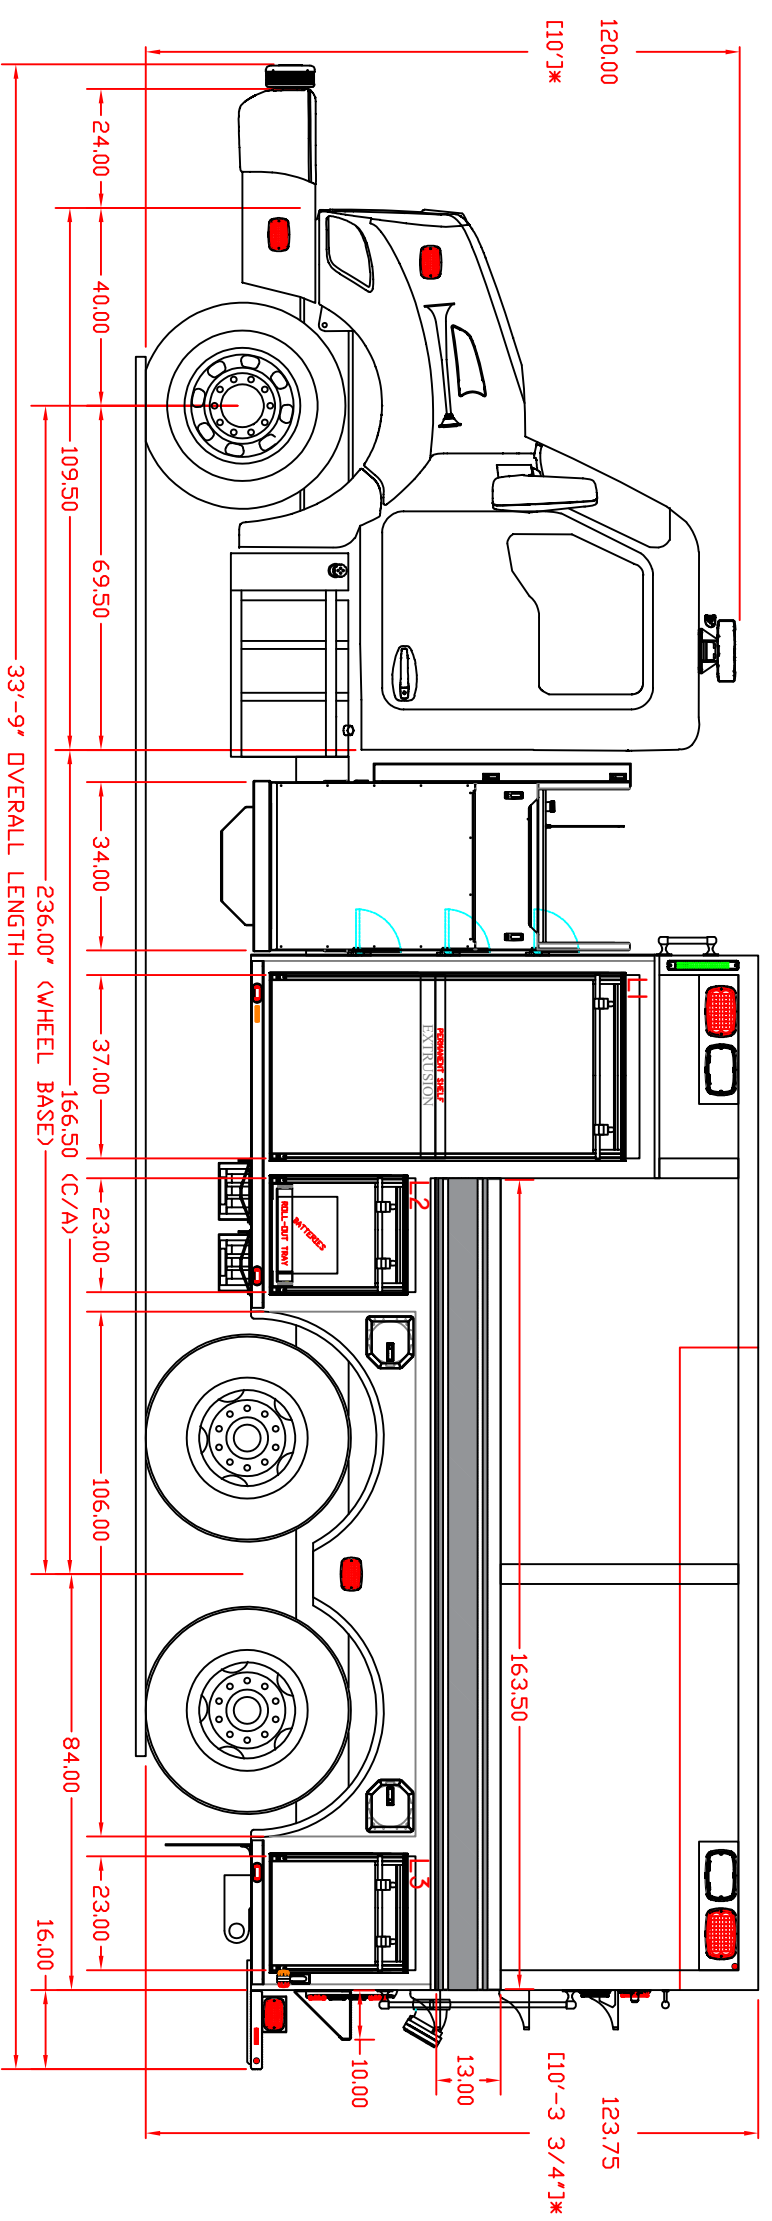

*HEIGHT COULD VARY +/- 2" BASED ON LOADING OF VEHICLE